


TYPICAL HOT WATER COIL PIPING

NOTE: This drawing is for main campus systems.
Community college systems are to be judged individually.

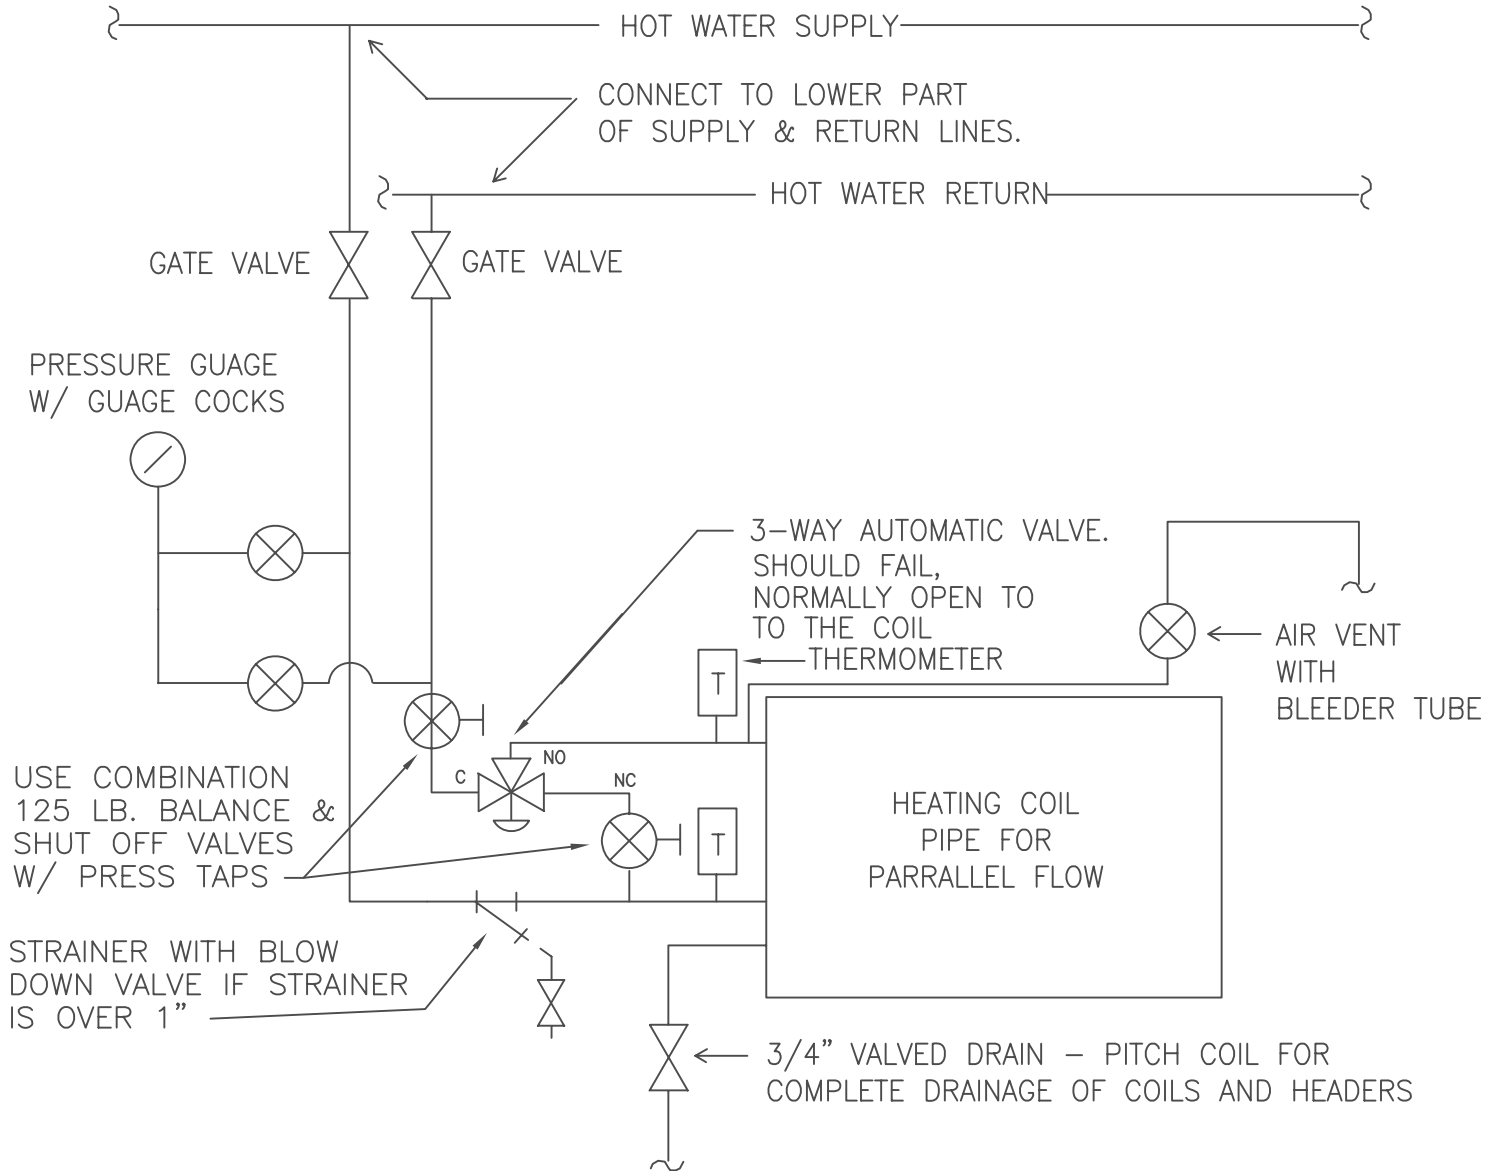

NOTES:

- USE THERMOWELLS FOR THERMOMETERS

SCALE: NONE



UNIVERSITY OF KENTUCKY DESIGN & CONSTRUCTION STANDARDS

DRAWN BY <u>GES</u>	REVISION <u>GSB</u> DATE <u>11/2/89</u>	TITLE : HOT WATER COIL PIPING	DRAWING NO. <u>15855D02</u>
APP. BY <u>MA</u>	<u>RLM</u> <u>11/26/90</u>		
DATE <u>7/86</u>	<u>JG</u> <u>2/28/91</u>		