


SAW CUT BLACKTOP SURFACE BACK 6" MIN. TO SOLID SURFACE AND PATCH TO MATCH EXISTING, BOTH SIDES.

NOTE:
WHERE UNDER CITY, STATE OR FEDERAL ROADWAYS, OBTAIN PROPER PERMITS AND REPAIR TO THEIR SPECIFICATIONS.

ROADWAY CUTS
UNDER 600 VOLTS

PATCH TO MATCH EXISTING SURFACE
COMPACTED DIRT IN 6" LAYERS
CONCRETE WITH RED DYE


6"
MIN.

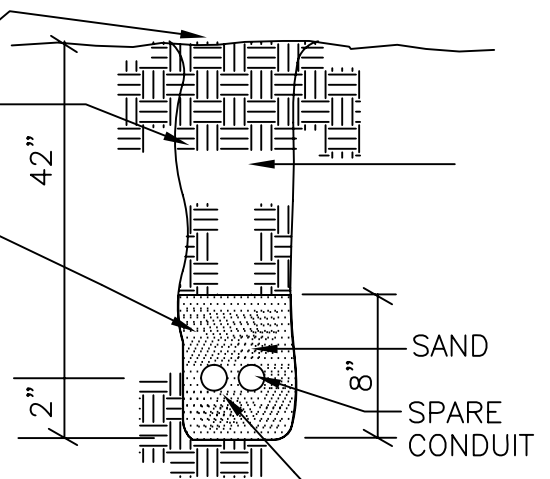

PVC SCHEDULE 40 OR RIGID GALVANIZED CONDUIT

OVER 600 VOLTS

NOTE:
ADD CONDUIT IN GROUPS OF TWO.

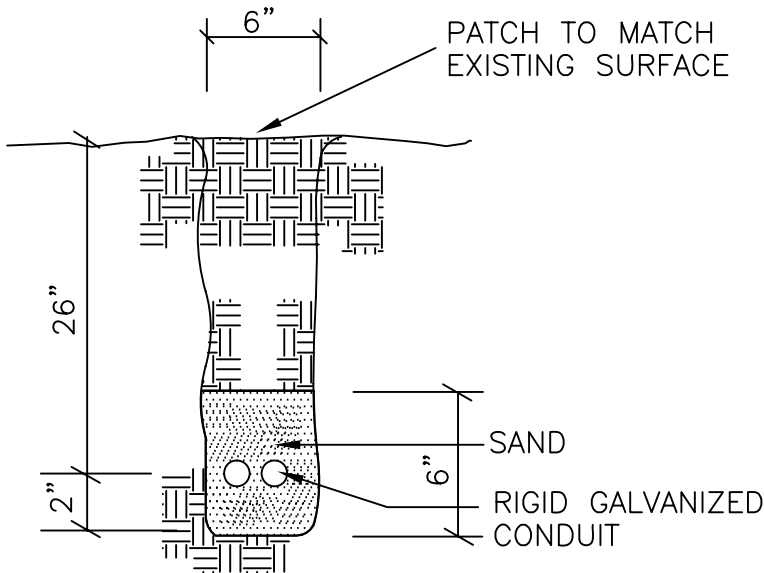

UNDER 600 VOLTS



UNIVERSITY OF KENTUCKY DESIGN & CONSTRUCTION STANDARDS

DRAWN BY <u>DG</u> APP. BY _____ DATE <u>6/86</u>	<table border="1"> <thead> <tr> <th>REVISION</th> <th>DATE</th> </tr> </thead> <tbody> <tr> <td> </td> <td> </td> </tr> <tr> <td> </td> <td> </td> </tr> </tbody> </table>	REVISION	DATE					TITLE : CONSTRUCTION DETAILS UNDERGROUND CONDUIT	DRAWING NO. <u>16110D01</u>
REVISION	DATE								