

## A Dynamic Control System for Scheduling Mist Propagation in Poinsettia Cuttings


Robert Geneve, Richard Gates, Sergio Zolnier, James Owen and Sharon Kester.

Department of Horticulture, Department of Biosystems and Agricultural Engineering.  
University of Kentucky, Lexington, KY 40546

Introduction: Major greenhouse crops, (poinsettia, chrysanthemum, and geranium), as well many woody nursery crops are propagated by softwood cuttings. The typical propagation system used to root cuttings is open bench misting. Although, cuttings from many species are remarkably tolerant of variable environments in the mist bench, mist propagation as currently employed can be an inefficient use of inputs such as water and electricity. This is the consequence of static control systems for controlling the interval between misting events. In some cases, inappropriate control of misting intervals can reduce or delay root formation by allowing cuttings to wilt, leaching nutrients from the leaf or saturating the medium with water. In contrast, dynamic systems for controlling mist rely on plant or environmental signals to estimate the water status of cuttings. Several alternatives to static control have been developed including simulated mechanical or electronic leaves, light sensors and humidistats (Hartmann et al. 1997). The objective of the current study was to evaluate an evapotranspiration model (Zolnier et al. 1998) for scheduling misting for poinsettia cuttings under summer greenhouse conditions.

Commercial poinsettia production starts with propagation of terminal cuttings taken from stock plants during mid-summer in the United States. Summer season greenhouse environments are typically most severe because of high solar radiation, temperature and air vapor pressure deficit (VPD). Because poinsettia terminal cuttings are initially un-rooted, the

propagation effort is focused on providing an optimal environment for the cuttings until they develop roots, typically three to four weeks. Water status of the cuttings must be maintained by maximizing water uptake and providing mechanisms to limit transpirational water loss (Mudge et al., 1995). Techniques such as intermittent mist, fogging systems, and shading control (Hartmann et al., 1997) that control VPD (Gates et al., 1998) can be used. VPD is the difference between the vapor pressure in the leaf ( $V_{\text{leaf}}$ ) and the vapor pressure of water in the air ( $V_{\text{air}}$ ). VPD is the driving force for water loss from leaves. Because cuttings are initially un-rooted, the propagator must limit transpiration. Fogging systems, humidity tents, and enclosed misting increase  $V_{\text{air}}$ , while open bench misting impacts  $V_{\text{leaf}}$  by water evaporating from the leaf surface, thereby reducing  $V_{\text{air}}$  and increasing  $V_{\text{leaf}}$ . Note that VPD of air is commonly used as a substitute for VPD leaf – air. This is acceptable so long as leaf temperature does not vary from air temperature by more than a few degrees.

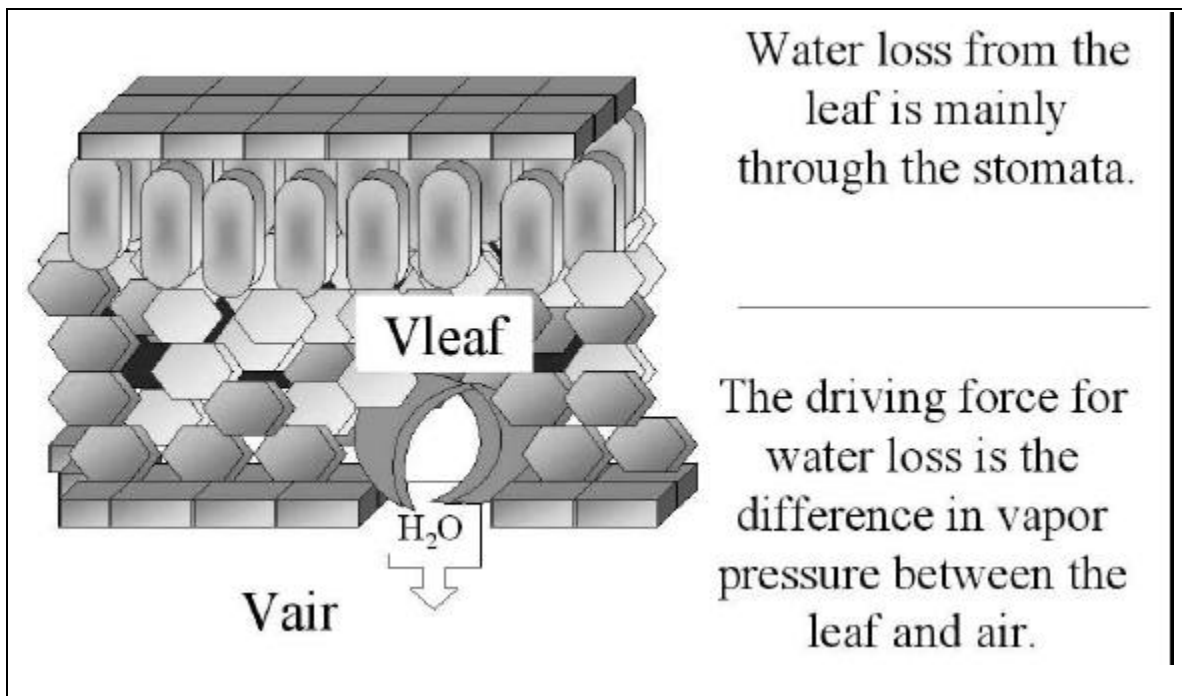

Recently, we have devised a dynamic misting control strategy for poinsettia propagation (Zolnier et al., 1998). Evaporation from cuttings is estimated from an energy balance (the Penman-Monteith equation) using parameters obtained from carefully controlled growth chamber experiments and online measurements of canopy temperature, air temperature and relative humidity, and light intensity (Zolnier et al., 1998). Mist is only activated when predicted evaporation reduces stored water in the canopy to below a threshold quantity.


### **Materials and Methods:**

Stockplants and cuttings: Poinsettia (*Euphorbia pulcherrima* 'Freedom') stock plants were maintained under standard greenhouse conditions and prevented from flowering by daylength control. Terminal cuttings (9 cm long) were treated with IBA (1000 ppm quick dip) and stuck in 1 peat:1 perlite (v/v) medium.

Mist chambers : Cutting were misted by four Netafilm nozzles suspended above the bench adjusted for uniform coverage. Four individual mist chambers (1.5 x 3 m) were independently controlled by computer. Two chambers were statically controlled for mist at five seconds every five minutes. The remaining two chambers were dynamically controlled using the evapotranspiration model (Zolnier et al., 1998). The computer recorded temperatures, misting times and calculated  $V_{\text{air}}$  every minute. Root number and length was recorded after 21 days.

## Results and Discussion:

The major difference between the two systems of mist control was the amount of water used. There was a 38% reduction in misting using the dynamic control system. This reduction in water usage should have resulted in a less wet propagation medium and could account for the differences seen in root length and diameter for the dynamically controlled cuttings. In general, the dynamic system of control misted more frequently during sunny conditions, and less frequently during morning, evening and cloudy times. This is illustrated by the number of times mist was activated during a typical sunny or partly cloudy day.

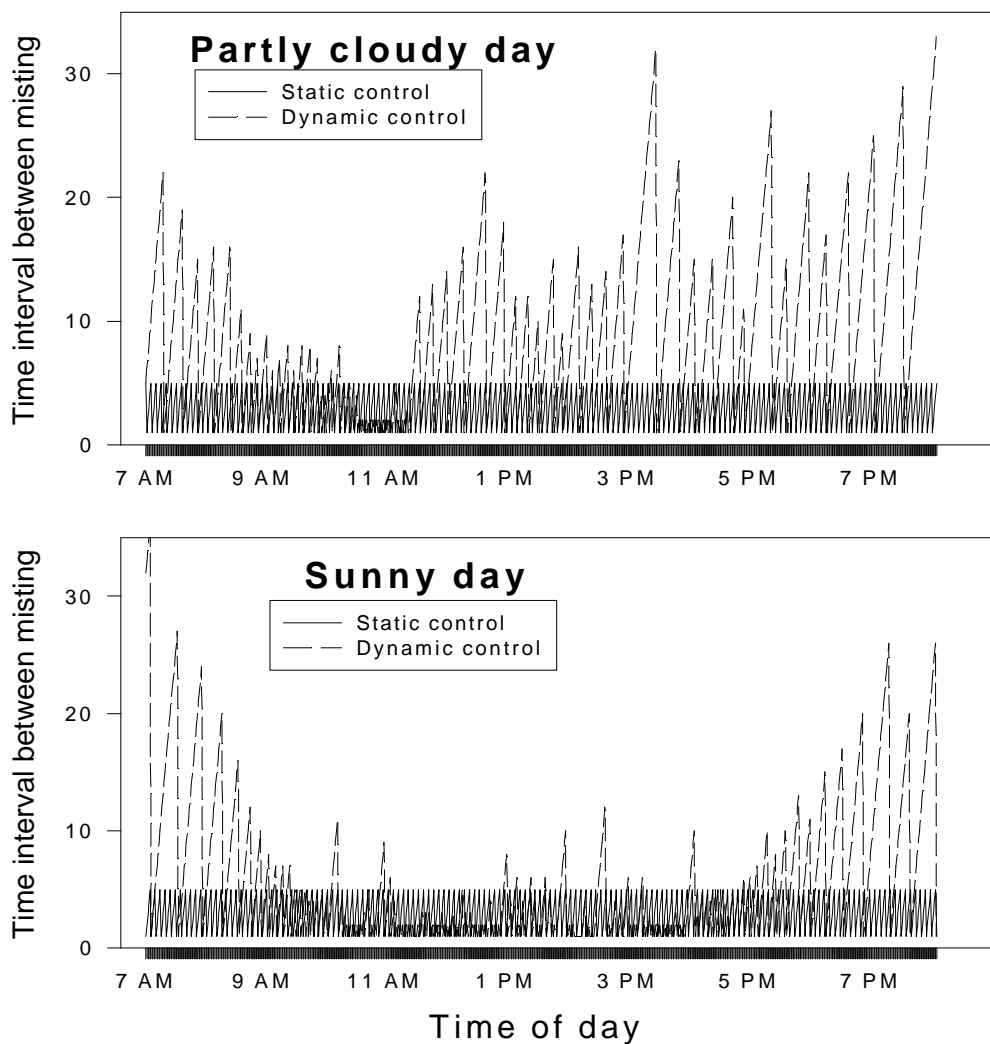

The number of roots per cutting did not vary between systems of mist control (static = 47.0; dynamic = 47.3 roots per cutting). There was also no difference in relative water content of the cuttings (a measure of water stress). Differences were seen in overall root length (static = 209; dynamic = 249 cm per cutting) and root dry weight (static = 89.0; dynamic = 101 mg per cutting). The percentage of fine roots (<0.8mm) was 24.5% greater in the cuttings controlled by the dynamic system. Poinsettias are the highest value pot crop in the United States. Propagation is from softwood cuttings that are usually rooted under mist using static time control of fixed or traveling nozzles. While some growers may adjust this mist interval manually as water status in the cuttings warrant, timely adjustment is certainly not prevalent. Indeed, no clear criteria exist for assessing what constitutes proper misting adjustment, other than observing wilted cuttings. Thus, the on/off interval is selected to satisfy extreme mid-day conditions, and consequently excess water consumption occurs during cloudy days, mornings, evenings and in some cases during night time. Excess water also reduces O<sub>2</sub> availability in the roots of newly propagated cuttings. Growers are hesitant to make adjustments toward water conservation, because forgetting to re-adjust for high radiant conditions can quickly result in a lost crop. The mean wholesale value of poinsettias sold in 1997 was about \$3.70 per potted plant (USDA, 1998); it is common for propagators to have tens of thousands of terminal cuttings under propagation at one time. Mistakes during propagation can have serious economic impact. The model tested in this paper is one approach to dynamic mist control. It has proven to be a good predictor of misting frequency for poinsettia propagation. Additional testing will be required to optimize this system for poinsettia and to extend it to the general propagation of other crops.

**References:**

- Gates, R.S., S. Zolnier and J. Buxton. 1998. Vapor pressure deficit control strategies for plant production. pp 283-288, IN: Proc. First IFAC Workshop on Control Applications and Ergonomics in Agriculture, 14-17 June, Athens, Greece. Elsevier Science Ltd, Oxford England.
- Hartmann, H.T., Kester, D.E., Davies, F.T.J. and R.L. Geneve. 1997. Plant Propagation – Principles and Practices. 6<sup>th</sup> ed., Prentice Hall. Upper Saddle River, NJ. 770 pp.
- Mudge, K.W., Mwaja, V.N., Itulya, F.M. and J. Ochieng. 1995. Comparison of four moisture management systems for cutting propagation of Bougainvillea, Hibiscus, and Kei apple. J. Am Soc Hort. Sci. 120(3):366-373.
- USDA. 1998. Floriculture Crops 1997 Summary. USDA National Agricultural Statistics Service. April. 101 pp. (<http://usda.mannlib.cornell.edu/reports/nassr/other/zfc-bb/>)
- Zolnier, S., R.S. Gates, R.L. Geneve, J.W. Buxton and S.E. Nokes. 1998a. Canopy surface resistance of rooted poinsettia cuttings under controlled environment conditions. Presented at 1998 ASAE Annual Intl. Mtg., Paper No 984161. ASAE, 2950 Niles Rd, St. Joseph, MI 49085-9659 USA.