


CONDUCTIVITY READINGS

STANDARDS CHART FOR 21-8-18

1 mS (DiST 4 meters)

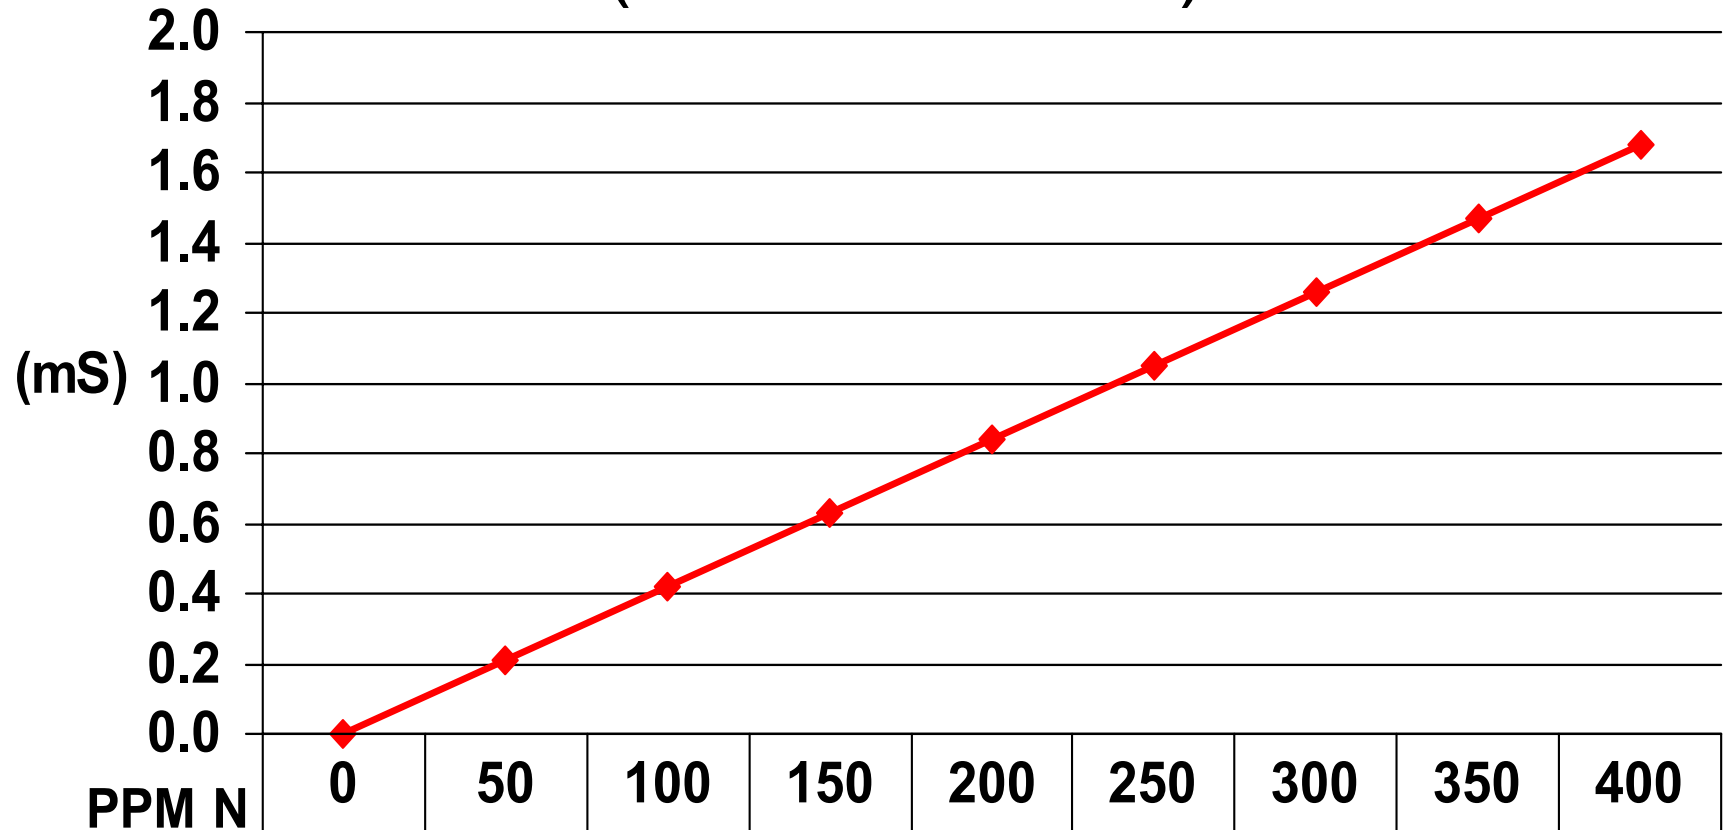

◆ Salt Content	0.00	0.21	0.42	0.63	0.84	1.05	1.26	1.47	1.68
----------------	------	------	------	------	------	------	------	------	------

1. TAKE WATER SOURCE READING (PLAIN WATER) 2. TAKE FERTILIZED WATER READING
3. SUBTRACT WATER SOURCE FROM FERTILIZED EXAMPLE: IF PLAIN WATER = .4 & FERTILIZED
WATER = 1.00, $1.4 - .4 = .6$, PPM N = approx 150