



ALL CONCRETE PADS POURED FOR THE INSTALLATION OF ELECTRICAL EQUIPMENT SHALL BE CROWNED IN THE CENTER TO PROVIDE POSITIVE WATER DRAINAGE. MINIMUM SLOPE OF 1 INCH PER TWO FEET, PROVIDED THE SLOPE DOES NOT INTERFERE WITH THE EQUIPMENT INSTALLATION.

OUTDOOR PAD MOUNTED ELECTRICAL EQUIPMENT (INCLUDING TRANSFORMERS) HAVE SUFFERED DAMAGE IN THE PAST DUE TO EVAPORATION AND CONDENSATION OF RAIN WATER TRAPPED UNDER THE EQUIPMENT ON THE PAD.

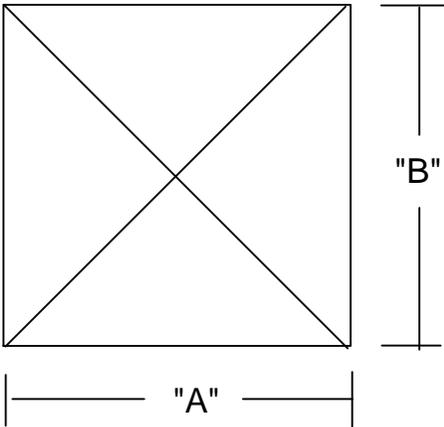

TOP VIEW

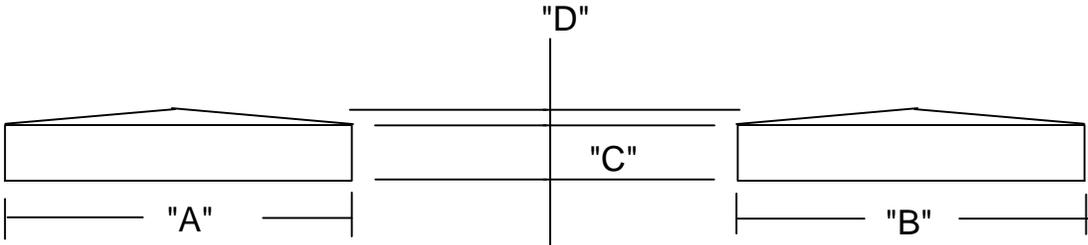

FRONT VIEW

SIDE VIEW

DIMENSION "D" SHALL BE 1/48 OF "A" OR "B" WHICHEVER IS GREATER, RESULTING IN A MINIMUM SLOPE OF 1 INCH FOR EVERY 2 FEET

033100D01 STRUCTURAL CONCRETE - detail
 Dated: 12/2015
 Applies to: All Projects
 University of Kentucky



UNIVERSITY OF KENTUCKY DESIGN & CONSTRUCTION STANDARDS

DRAWN BY <u> JRZ </u> APP. BY _____ DATE <u> JAN. 87 </u>	REVISION DATE _____ _____ _____	TITLE : ELECTRICAL EQUIPMENT PADS CONCRETE - EXTERIOR	DRAWING NO. _____ 033100D01
---	--	---	-----------------------------------