


233816D02 FUME HOODS - DETAILS

Typical Installation

Note: Flexible connections are to be avoided in perchloric acid systems. Rigid connections are preferred.

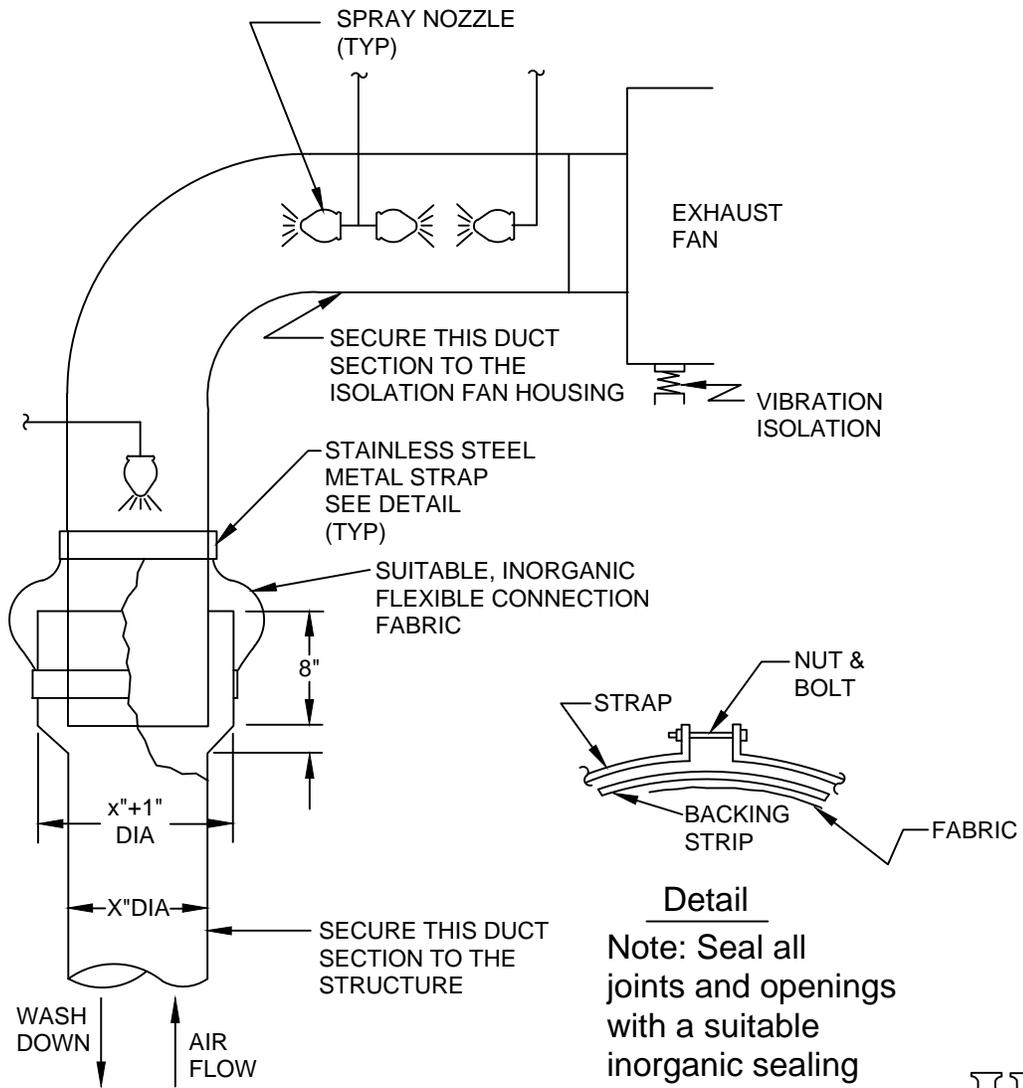

UNIVERSITY OF KENTUCKY DESIGN & CONSTRUCTION STANDARDS

DRAWN BY <u>MA</u> APP. BY <u>MA</u> DATE <u>11-23-88</u>	REVISION DATE _____ _____ _____	TITLE : PERCHLORIC ACID HOOD VIBRATION ISOLATION	DRAWING NO. 233816D02
---	---	---	-------------------------------------